


# FLP-12,5 V/2

## SPD - for low voltage / SPD type 1 / MOV

Lightning current and surge arrester for single-phase system TN-S  
pluggable module, visual fault signalling, module locking

- two-pole varistor lightning current arrester
- installation at the boundary of zones LPZ 0 and LPZ 1 or higher, for objects in LPL III and IV
- for protection against impact of partial lightning currents, induced overvoltages during a lightning strike or switching overvoltages

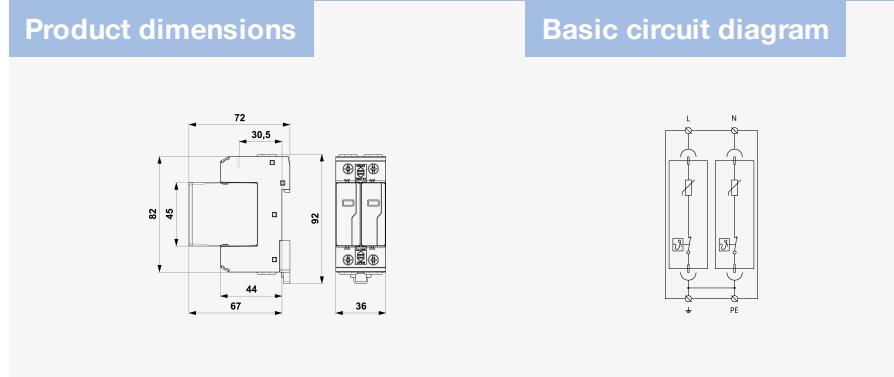

Parameter name	Parameter value
Type of SPD	T1,T2
Mounting	DIN rail 35 mm
Nominal voltage	$U_n$
	230 V AC
Maximum operating voltage	$U_c$
	275.00 V AC
Maximum operating voltage	$U_c$
	350.00 V DC
Type of network	TN
Maximum overcurrent protection	160 A gL/gG
Short-circuit current rating	$I_{SCCR}$
	50.0 kA
Total discharge current (10/350 $\mu$ s)	$I_{Total(10/350)}$
	25.00 kA
Lightning impulse current (10/350 $\mu$ s)	$I_{imp}$
	12.50 kA
Nominal discharge current (8/20 $\mu$ s)	$I_n$
	30.00 kA
Maximum discharge current (8/20 $\mu$ s)	$I_{max}$
	60.00 kA
Voltage protection level	$U_p$
	1.50 kV
Voltage protection level at 5 kA	$U_p$
	0.90 kV
Response time	$t_a$
	25 ns

TOV 5 s L-N	335 V
TOV characteristic (TOV 5 s)	withstand
Cross-section of connected conductors solid (min)	1.00 mm <sup>2</sup>
Cross-section of connected conductors solid (max)	35.00 mm <sup>2</sup>
Cross-section of connected conductors stranded (min)	1.00 mm <sup>2</sup>
Cross-section of connected conductors stranded (max)	25.00 mm <sup>2</sup>
Fault indication	red indication field
Degree of protection	IP 20
Range of ambient temperatures (min/max)	-40 / 80 °C
Humidity	5 - 95 %
According to standard	EN 61643-11:2012, IEC 61643-11:2011
ETIM Class	EC001457
Plug module	FLP-12,5 V/0
Customs tariff number	85363090
EAN	8595090538097
Order number	A03809

SALTEK s.r.o., Dráždanská 561/85, 400 07 Ústí nad Labem, CZ | +420 475 655 511 | [info@saltek.cz](mailto:info@saltek.cz) |  
[www.saltek.eu](http://www.saltek.eu)  
*Technická podpora: 800 818 818 | [podpora@saltek.cz](mailto:podpora@saltek.cz)*

12.05.2024 -  
 14:24:51